

230V AC Existing Supply




Existing Switch

5VDC 9VDC 12VDC

Or Required Voltage


Switch to POE Interface Unit

Power +
Batty Backup
(Optional)

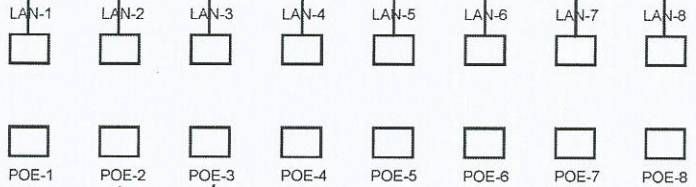

← Cat-5 Patch Co

← Cat-5 Patch Co

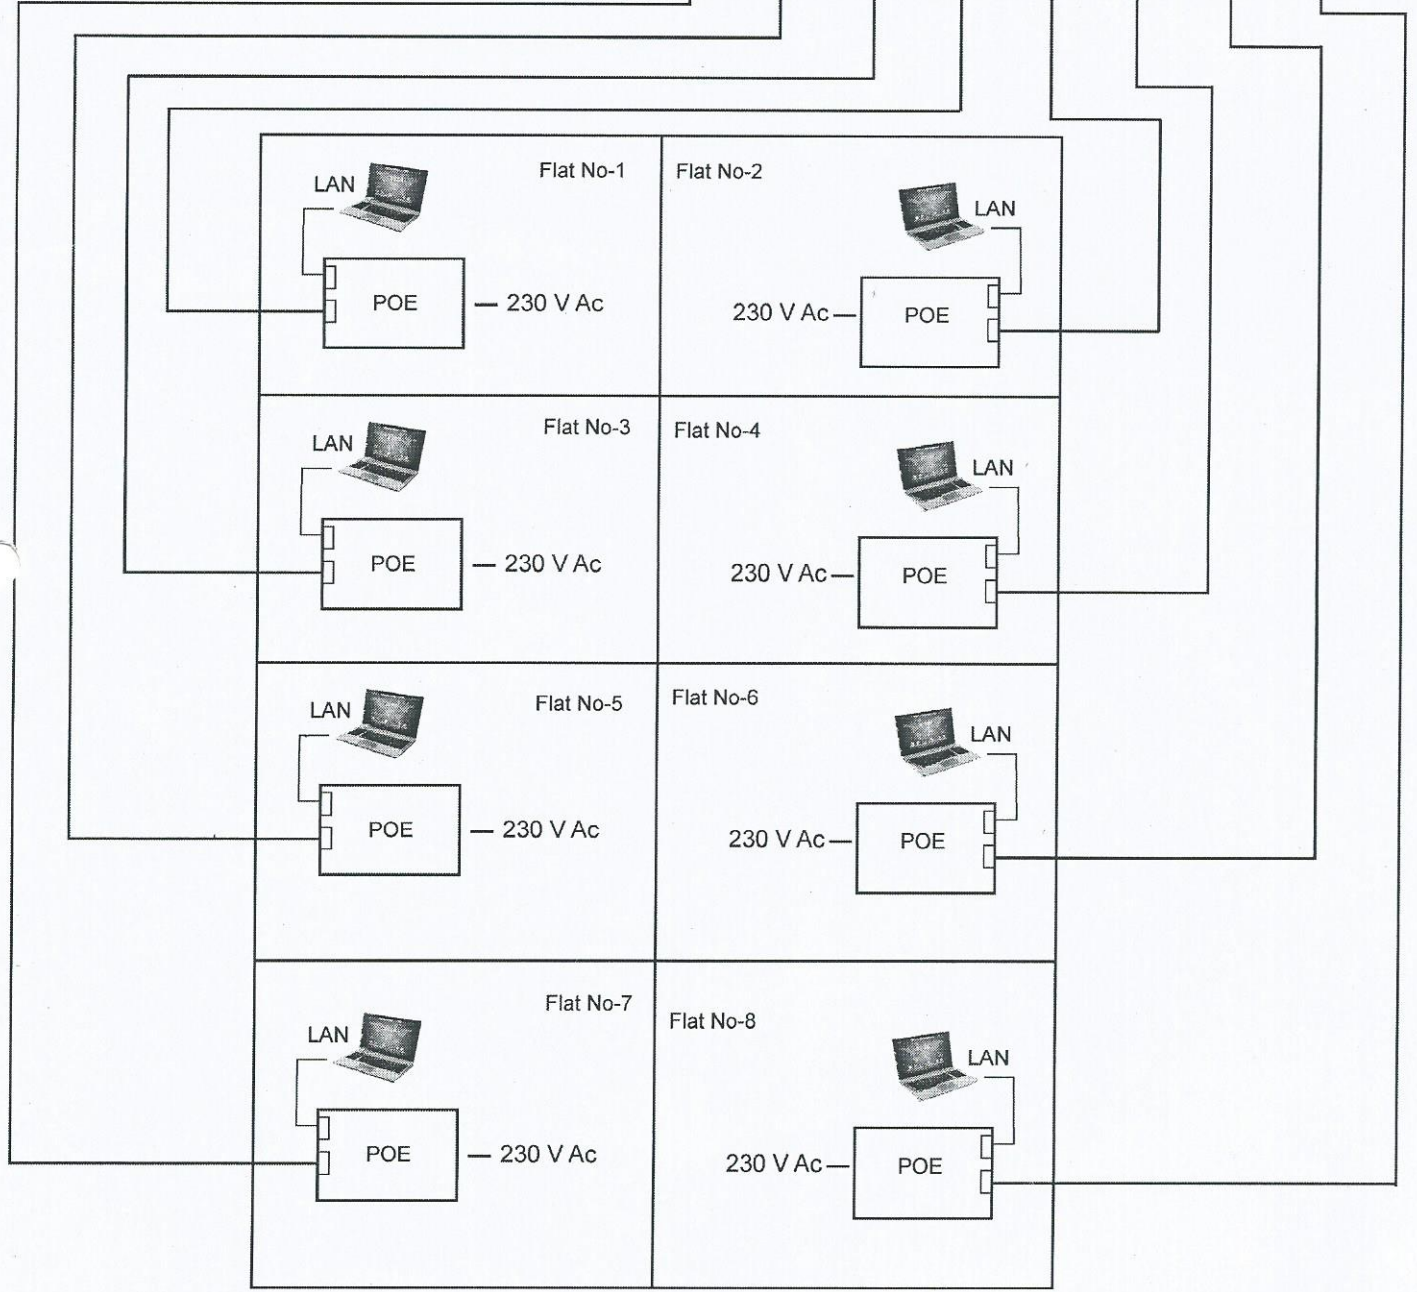

Building